



Report On  
Surface Burning Characteristics  
Determined By  
ASTM E 84 Twenty-Five Foot  
Tunnel Furnace Test Method

PREPARED FOR:  
Novawall Systems, Inc.  
Alexandria, VA

TEST NUMBER T-13159

MATERIAL TESTED:  
1/2" Reveal System, 1" Thick

DATE OF ISSUE 6/25/2009



**I. SCOPE**

This report contains the reference to the test method, purpose, test procedure, rounding procedures, preparation and conditioning of specimens, description of materials, test and post test observation data, and test results.

**II. TEST METHOD**

The test was conducted in accordance with ASTM E 84, "Standard Test Method for Surface Burning Characteristics of Building Materials." The 25-foot tunnel method is also described by NFPA 255 and UL 723.

**III. PURPOSE**

The purpose of the test is to determine the relative performance of the test material under standardized fire exposure. Results are given for Flame Spread and Smoke Developed Index. The values obtained from burning the test material represent a comparison with that of 1/4" inorganic reinforced cement board expressed as zero and red oak flooring expressed as 100.

The flame spread results of 25-foot tunnel tests are frequently used by building code officials and regulatory agencies in the acceptance of interior finish material for various applications. The most widely accepted classification system is epitomized by the National Fire Protection Association Life Safety Code, NFPA 101:

Class A*	0 - 25	flame spread	0-450	smoke developed
Class B*	26 - 75	flame spread	0-450	smoke developed
Class C*	76 - 200	flame spread	0-450	smoke developed

\*Class A, B and C correspond to I, II and III, respectively, in other codes such as UBC and BOCA.

This flame spread classification system is based on the premise that the higher the flame spread numbers, the greater the fire spread potential. The actual relationship between the numbers developed under this test and life safety from fire has not been adequately established.

**IV. TEST PROCEDURE NOTES**

The furnace was preheated to a minimum of 150°F as measured by an 18 AWG thermocouple embedded in cement 1/8" below the floor surface of the chamber, 23-1/4' from the centerline of the ignition burners. The furnace was then cooled to 105°F (± 5°F) as measured by a thermocouple embedded 1/8" below the floor surface of the test chamber 13' from the fire end.

Prior 10-minute tests with 1/4" inorganic reinforced cement board provided the zero reference for flame spread. Periodic 10-minute tests with unfinished select grade red oak flooring provided for the 100 reference for flame spread and smoke developed as noted in Section III.



(Page 3 of 7)

A. Flame Spread

The flame spread distance is observed and recorded at least every 15 seconds or every 2 feet of progression. The peak distance is noted at the time of occurrence. The flame spread distance is plotted over time. The total area under the flame spread distance-time curve is determined; flame front recessions are ignored. The flame spread is then calculated as a function of the area under the curve relative to the standard red oak curve area. The value for flame spread classification for the tested material may be compared with that of inorganic reinforced cement board and select grade red oak flooring.

B. Smoke Developed

The smoke developed during the test is determined by the reduction in output of a photoelectric cell. A light beam vertically orientated across the furnace outlet duct is attenuated by the smoke passing through the duct. The output of the photoelectric cell is related to the obscuration of the light source through the duct caused by the smoke. A curve is developed by plotting photoelectric cell output against time. The value of smoke developed is derived by calculating the net area under the curve for the test material and comparing this area with the net area under the curve for unfinished select grade 23/32" red oak flooring.

**V. FLAME SPREAD AND SMOKE DEVELOPED ROUNDING PROCEDURES**

Single test calculated flame spread and smoke developed values are rounded to the nearest multiple of 5 and reported as the Flame Spread or Smoke Developed Index. Actual test values are available on request.

For multiple tests, the individual calculated flame spread and smoke developed values are recorded, averaged, and the results rounded to the nearest multiple of 5. The averaged, rounded number is reported as the Flame Spread or Smoke Developed Index.

**VI. PREPARATION AND CONDITIONING OF TEST SAMPLES**

Three or four sections are generally used in the preparation of a complete test specimen which is 20-1/2" wide and 24' long. Materials 8' in length may be tested by using three sections 20-1/2" wide by 8' long for a total specimen length of 24'. A 14" length of uncoated 16 gauge steel sheet is used to make up the remainder of the test specimen; it is placed at the fire end of the test chamber. Prior to testing, three 8' long sections of 1/4" inorganic reinforced cement board are placed on the back side of the specimens to protect the furnace lid assembly. Test specimens are conditioned at a controlled temperature of 73.4°F ( $\pm 5^\circ\text{F}$ ) and a controlled relative humidity of  $50 \pm 5$  percent.



**VII: MATERIAL TESTED**

- 1) Manufacturer: Novawall Systems, Inc.  
Alexandria VA
- 2) Burn Number: 1
- 3) Average Thickness(in.): 1.740
- 4) Average Weight (lbs./sq.ft.): 3.341
- 5) Average Groove Depth (in.):
- 6) Product Description: 1/2" Reveal System, 1" Thick  
Site fabricated stretch fabric system. Please see attached sheet for complete product description.
- 7) Color: Maroon
- 8) Surface: Face Side Exposed
- 9) Sample Selection: Manufacturer
- 10) Date of Selection: 6/24/2009
- 11) Material Description By: Manufacturer
- 12) Method of Mounting: Self-Supporting \*See Remarks
  
- 13) Sample Conditioning: 1

**VIII: TEST CONDITIONS AND DATA**

- 1) Specimen Preheat Time (min.) 2:00
- 2) Tunnel Brick Temp (deg. F): 103
- 3) Ignition Time (seconds): 17
- 4) Time to End of Tunnel  
or Flamefront Distance: 4' @ 4:15
- 5) Time-Distance Curve Area  
(min./ft.): 35.7
- 6) Fuel and Temperature
  - a) Fuel (cu.ft./min.): 5.283
  - b) Max. Vent End Temp. (deg.F): 599
  - c) Time to Max. Temp (min.): 6:56
- 7) After Flaming: Yes



TEST NUMBER T-13159

Page 5 of 7

DATE OF TEST 6/25/2009

**IX: TEST RESULTS**

Test results calculated on the basis of the area under the curves of flame spread distance and smoke developed versus time are provided in the table below for calibration materials and for:

1/2" Reveal System, 1" Thick

Material Description	Flame Spread Index	Smoke Developed Index
High Density Inorganic Reinforced Cement Board	0	0
Red Oak Flooring	100	100
T-13159	20	300

Observations:

Burned through the fabric to 20' and charred the midseam to 16'.

Remarks:

\*Mounting was designed to create a joint condition centered longitudinally between the gas burners on each piece. The mount complies with ASTM 2573-07 Standard Practice for Specimen Preparation and mounting of site-fabricated stretch wall systems.

Conclusions:

Meets Class A, Flame Spread Index 25 or less and Smoke Developed Index 450 or less.

REPORT PREPARED BY:

Thomas Wilson


Manager of Fire Testing and Field Inspections

REPORT REVIEWED BY:

Brian Sause


Director of Testing, Certification, and Standards

Conformance to the test standard is verified by a registered professional engineer. This is a factual report of the results obtained from laboratory tests of sample products. The results may be applied only to the products tested and should not be construed as applicable to other similar products of the manufacturer. The HPVA does not verify the description of materials and products when the description is provided by the client. The report is not a recommendation or a disapprobation by the Hardwood Plywood and Veneer Association of the material or product tested. While this report may be used for obtaining product acceptance; it may not be used in advertising.

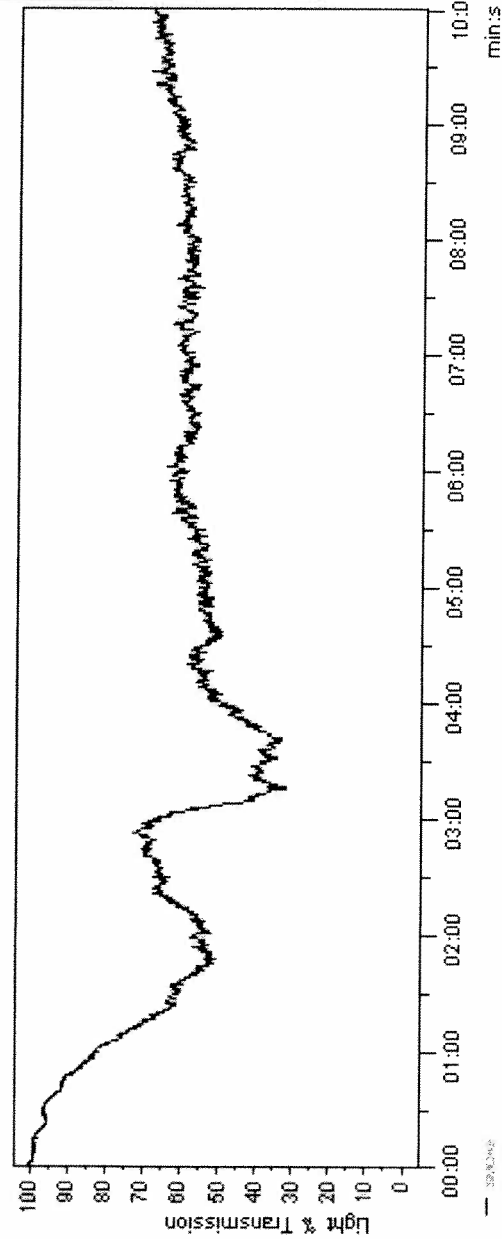

### Smoke Data


Max Temp = 599  
 @ Time = 416

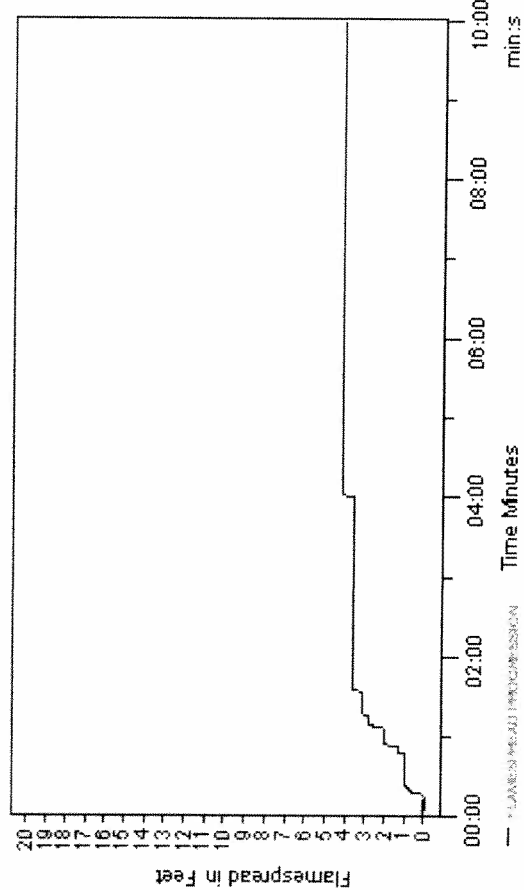

### Flamespread Data

<b>Test Time</b>	<b>FS Counts</b>
600	35.7
<b>seconds</b>	<b>Fuel Counts</b>
	750
<b>STOP Early</b>	<b>Smk Cts</b>
<b>NEW TEST</b>	690
<b>program</b>	

Flame Progression, Feet 21.88  
 Smoke MW 6.25  
 24 Ft. Temp, Deg. F 587  
 13 Ft. Temp, Deg. F 189  
 24 Foot Floor TC, Deg. F 130

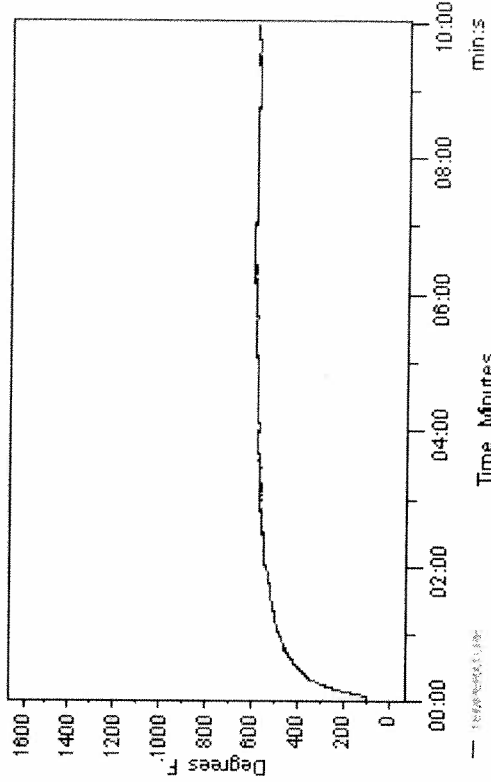

### Fuel Data



**LABORATORY ACCREDITATION**

HPVA is a recognized ASTM E 84 testing laboratory by the following building code organizations under the Council of American Building Officials Report No. NER-TL329 and ICBO Evaluation Service Report No. TL 224.

International Conference of Building Officials  
 Building Officials and Code Administrators, International  
 Southern Building Code Congress International, Inc.


**HPVA FLAME SPREAD PROPERTY VERIFICATION PROGRAM**

The Hardwood Plywood & Veneer Association provides a product property verification program for flame spread properties. This program is based on the selection and testing of panels within a given marketing line on the basis of that combination of factors that theoretically should give the highest flame spread values. Such factors as panel thickness, specific gravity, color of stain, type of lamination, surface texture, and product mix are taken into consideration in the selection of flame spread samples.

While it is standard procedure to include smoke developed values in test reports, the HPVA label identifies only the flame spread class.

The HPVA label is evidence that the marketing line has been tested and inspected in accordance with the HPVA Flame Spread Inspection and Verification Program Procedures.

The HPVA label displayed below indicates conformance of the tested samples to the Type II glue bond requirements as set forth in ANSI/HPVA HP-1-2004 Standard For Hardwood And Decorative Plywood, and conformance to Flame Spread Class C (200 or less) as determined by the test procedures described in ASTM E 84. Depending on the type of product, the label may also include other information such as structural and formaldehyde emission ratings.

HARDWOOD PLYWOOD & VENEER ASSOCIATION		
BOND LINE TYPE II ANSI/HPVA HP-1-2004	 MILL 00 SPECIALTY GRADE	FLAME SPREAD 200 OR LESS CLASS C ASTM E 84
		SIMULATED DECORATIVE FINISH ON PLYWOOD

Tom Wilson  
HPVA  
1825 Michael Faraday Drive  
Reston, Virginia 20190-5350  
Via Email: Tom Wilson [TWilson@hpva.org]

June 24, 2009

Hello

Here is the information for 1" thick test specimens with 1" 6 pcf fiberglass core and the 1/2" Reveal track. Please include the longitudinal midseam notation.

This sample is being submitted by:  
Novawall Systems, Inc.  
885-B South Pickett Street  
Alexandria, Virginia 22304  
Phone: 703-461-0113  
Fax: 703-461-0436

The test to be conducted is the ASTM E-84 (Twenty-Five Foot Tunnel Furnace Test Method) employing the ASTM E-2573 07 Standard Practice for Specimen Preparation and Mounting of Site Fabricated Stretch Fabric Systems to Access Surface Burning Characteristics.

**PRODUCT DESCRIPTION:** 1" (25mm) thick 1/2" Reveal System. The test specimen was fabricated in three 8' lengths by 20-1/2" wide panels or sections. Each section consisted of a sheet of 5/8" thickness drywall to which a complete Novawall® assembly was attached.

At the perimeter of each panel or section, edge extrusions were attached. 1/2" Reveal Midwall extrusions were attached to the drywall substrate to create a joint condition centered longitudinally between the gas burners on each panel or section. The joint condition was included to comply with ASTM E-2573 07 Standard Practice for Specimen Preparation and Mounting of Site Fabricated Stretch Fabric Systems to Access Surface Burning Characteristics. The procedure conditions used in the field must be included in a test if they may have an adverse effect on the test results. Midwall joint conditions are required in most Novawall® installations.

The cells or areas, bounded by the extrusions were filled by a 1" thick layer of 6 lb. pcf fiberglass attached with pneumatic staples. A fabric was stretched over the assembly and secured by means of the toothed channels of the extrusions. The fabric used was FR 701-2100 (100% Polyester), sold by Guilford of Maine. The fabric was not backed prior to installation on the test panels.

Please let me know if you have any questions.  
Have a nice day!  
Sincerely,



Pamela Marchesano  
Vice President  
Novawall Systems, Inc.